


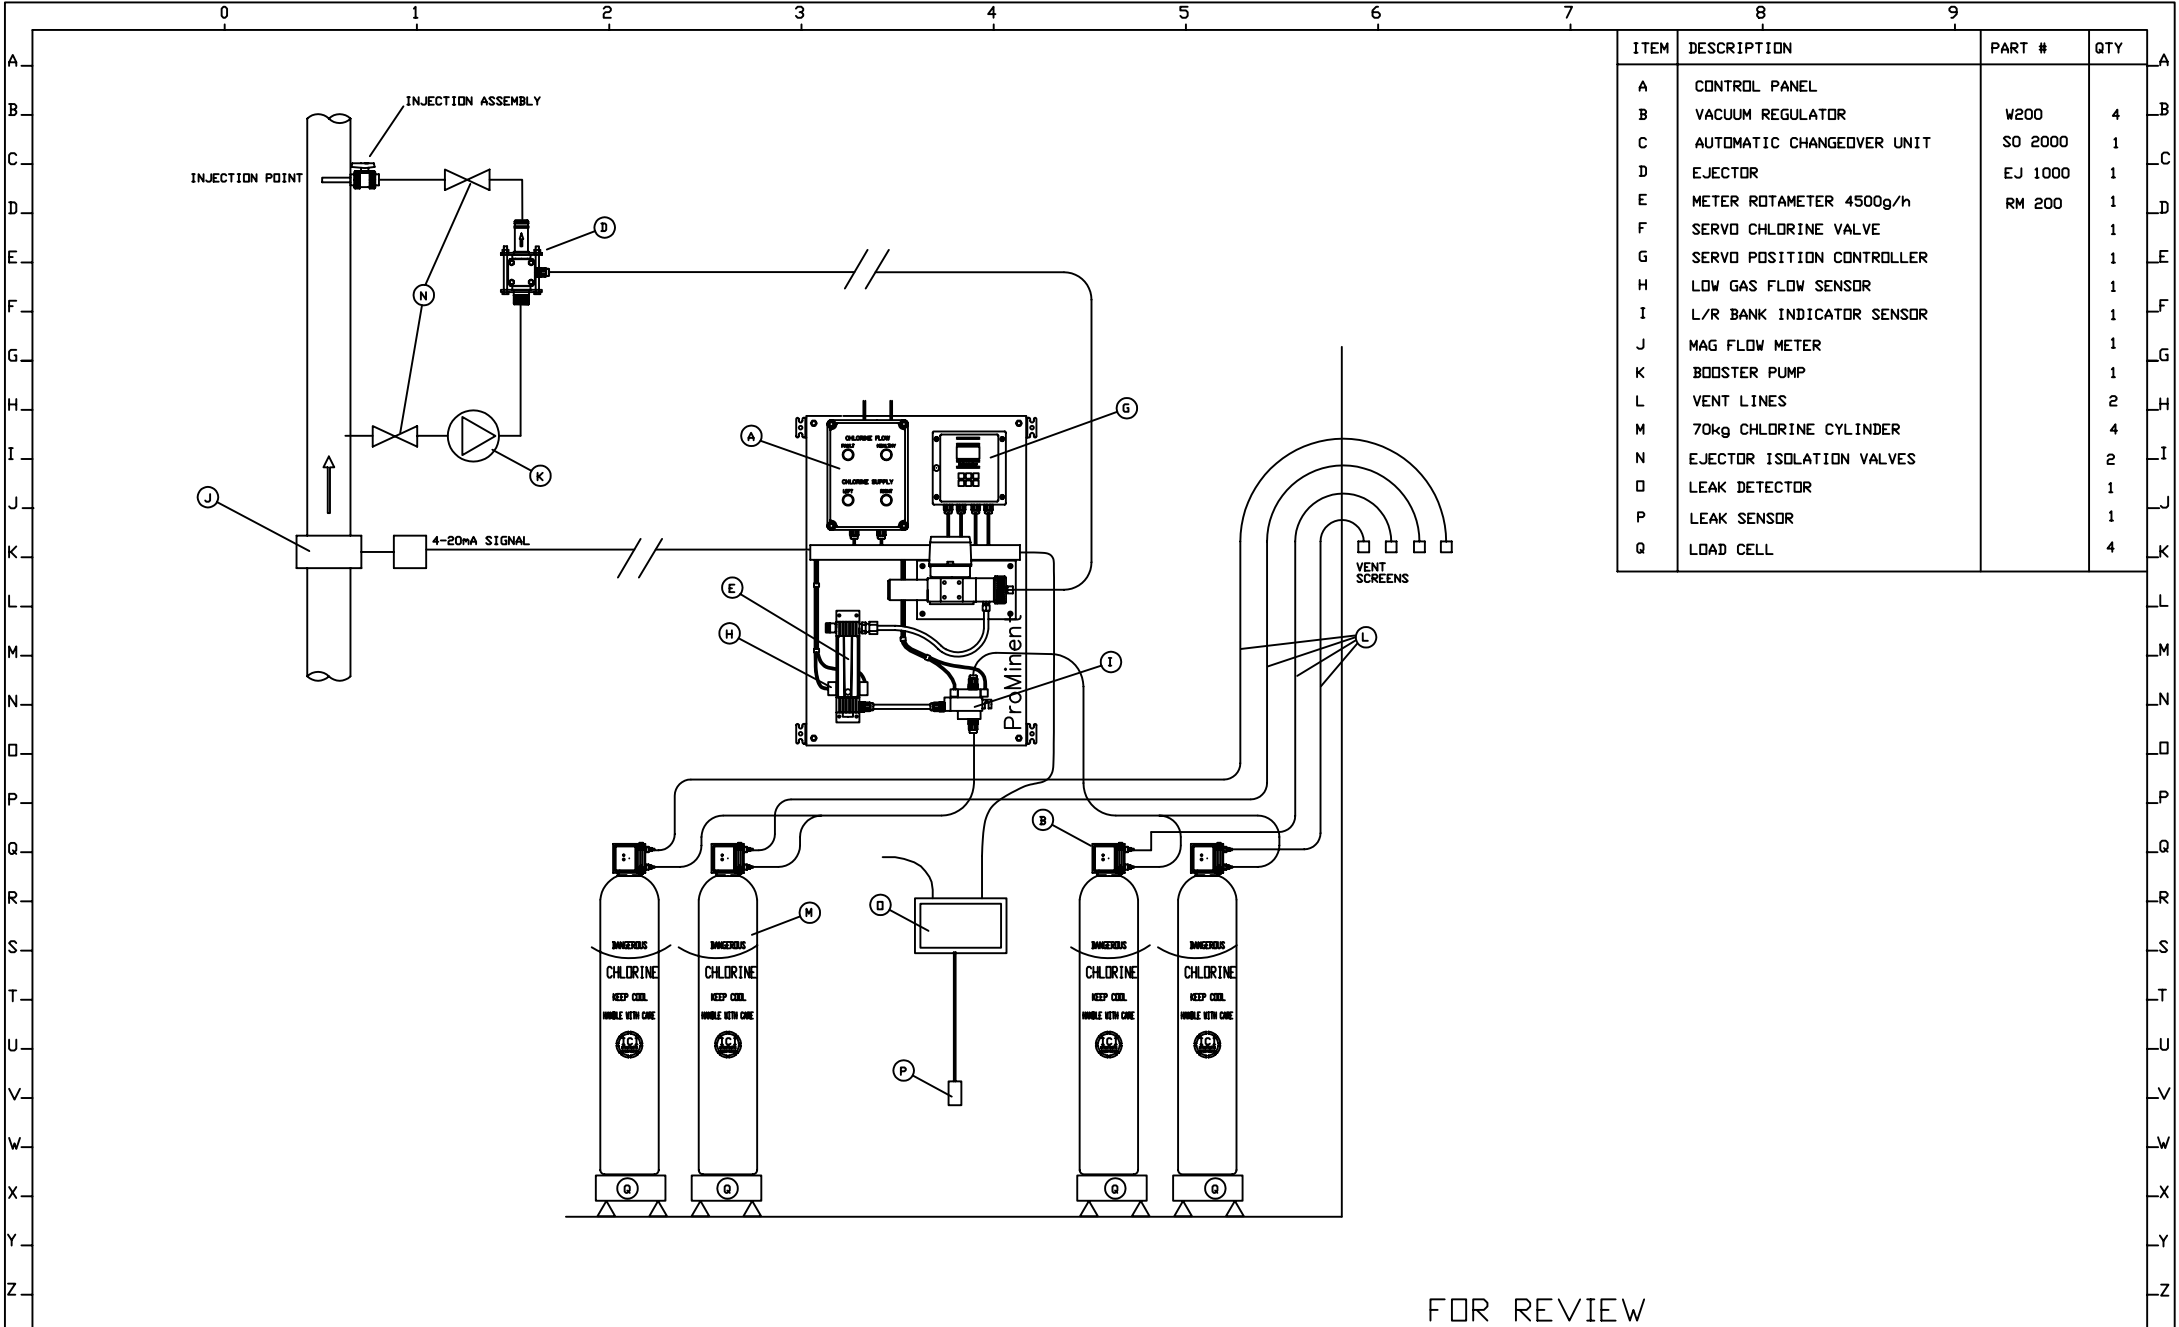

ITEM	DESCRIPTION	PART #	QTY
A	CONTROL PANEL		
B	VACUUM REGULATOR	W200	4
C	AUTOMATIC CHANGEDOVER UNIT	SO 2000	1
D	EJECTOR	EJ 1000	1
E	METER ROTAMETER 4500g/h	RM 200	1
F	SERVO CHLORINE VALVE		1
G	SERVO POSITION CONTROLLER		1
H	LOW GAS FLOW SENSOR		1
I	L/R BANK INDICATOR SENSOR		1
J	MAG FLOW METER		1
K	BOOSTER PUMP		1
L	VENT LINES		2
M	70kg CHLORINE CYLINDER		4
N	EJECTOR ISOLATION VALVES		2
O	LEAK DETECTOR		1
P	LEAK SENSOR		1
Q	LOAD CELL		4

REV:	DATE:	DESCRIPTION	APPROVED

This drawing remains the property of ProMinent Fluid Controls Pty Ltd. It shall not be copied in whole or in part, nor re-issued in any form to other parties without the express written approval of ProMinent Fluid Controls Pty Ltd.

TOLERANCES
LINEAR: ±1mm
ANGULAR: ±1 DEGREE
UNLESS STATED OTHERWISE

SCALE:
N.T.S.
CAD FILE NAME:
CL2GS-2

DRAWN: RDL	DATE: 08-12-98
CHECKED: SCC	DATE: 08-12-98

DRAWING PREPARED BY
ProMinent Fluid Controls Pty Ltd
Unit 4, 4 Narabang Way
BELROSE NSW 2085
Tel (02) 9450 0995
Fax (02) 9450 0996

PROMINENT FLUID CONTROLS
4 BOTTLE AUTO CHANGE
OVER AUTOMATIC Cl2
GAS INJECTION SYSTEM

FILE:
N: \DATA\ENG\QUOTATION DWGS\Cl2 GAS SYSTEMS

SHEET 1 OF 1

DRAWING NUMBER: CL2GS-2

REVISION: 0

ProMinent®